


NOTES:

1. IMPORTED WASHED SAND BEDDING/SHADING MATERIAL SHALL BE REQUIRED AND SHALL MEET THE GRADATION AND PLASTICITY INDEX / LIQUID LIMIT REQUIREMENTS NOTED IN MDWID SUPPLEMENTAL SPECIFICATION 0209.310. THE SAND BEDDING/SHADING MATERIAL SHALL BE PLACED IN ACCORDANCE WITH MDWID SUPPLEMENTAL SPECIFICATION 0209.0310 SUBSECTION (A).
2. TRENCH WIDTH SHALL BE PER PIPE MANUFACTURER'S SPECIFICATIONS.
3. FOR PLACEMENT OF POLYETHYLENE POTABLE WATER DETECTABLE PIPE LOCATING TAPE AND TRACER WIRE, SEE MDWID STANDARD DETAIL MW-116.

TRENCH BACKFILL MATERIAL AND COMPACTION SHALL BE IN STRICT ACCORDANCE WITH THE AGENCY WHICH HAS JURISDICTION OVER THE RIGHT-OF-WAY

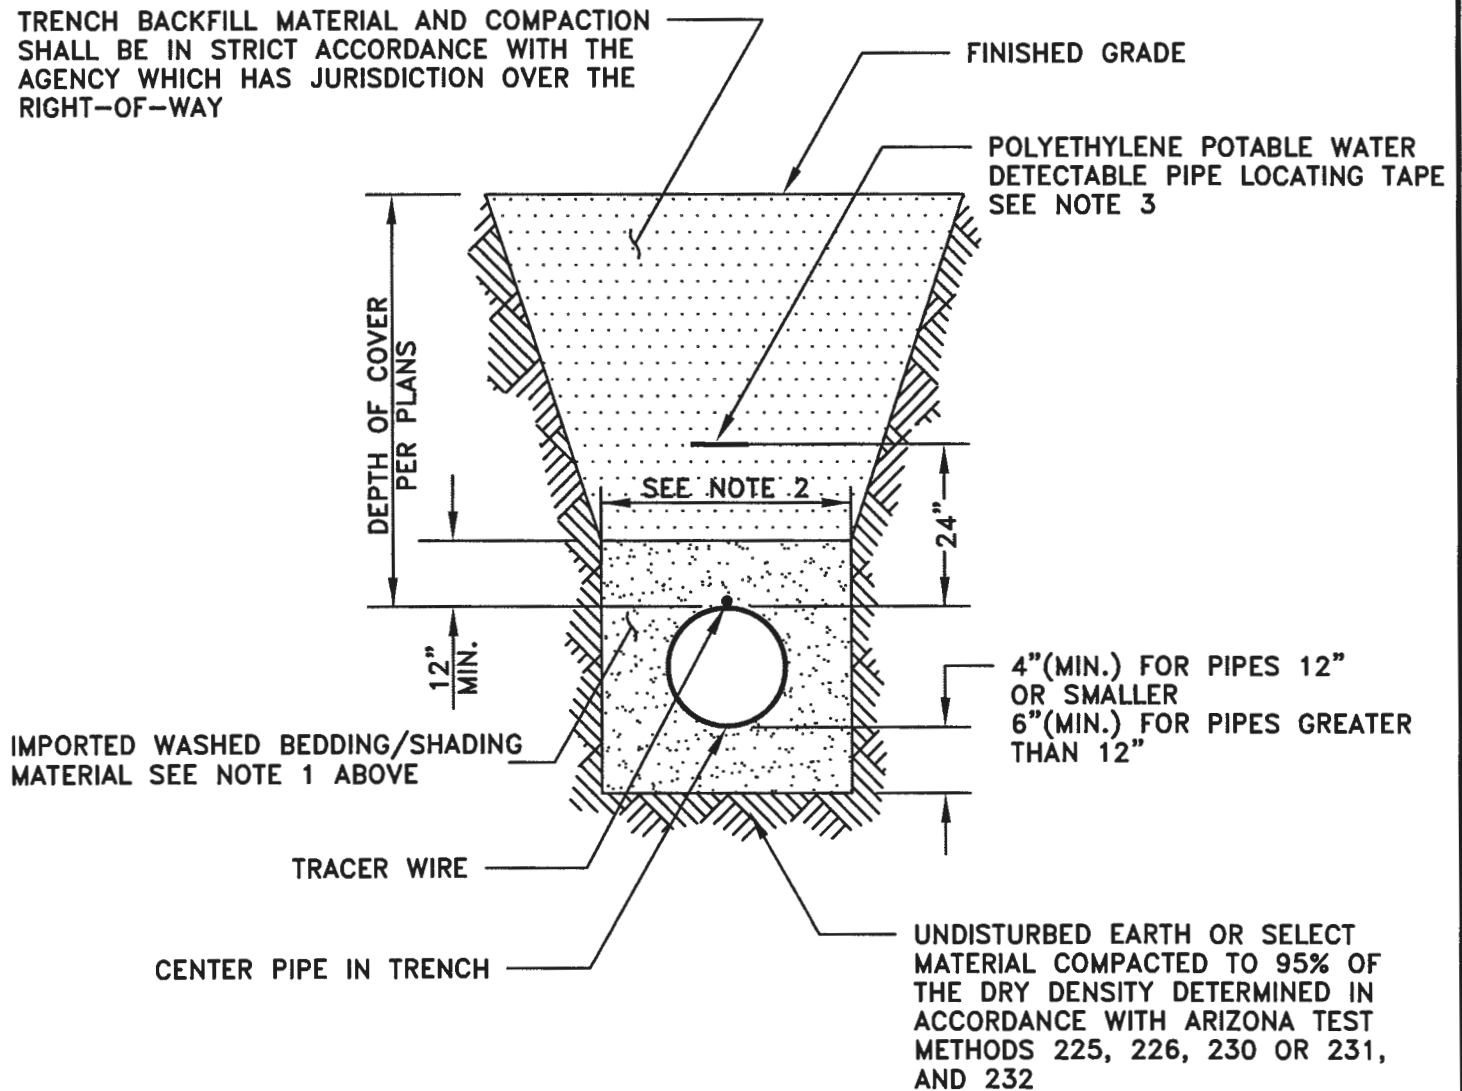

PIPE BEDDING & TRENCH BACKFILL

ISSUED: 01/99
REVISED: 07/2014

SCALE: N.T.S.

PAGE 1 OF 1

S.D.# **MW-115**